

UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
Page 1/8
Date of Issue 2021-09-28

Certificate Holder ROCKWOOL Ltd
Wern Tarw
Pencoed
Bridgend
South Wales
CF35 6NY

Manufacturer A/008

Certified Product Type Fire Stop - Coating
Product Trade Name Firepro Softseal System
Trademark N/A
Rating/Classification See Appendix

Harmonised Technical Specifications ETAG 026-3 / EN 13501-2
Expiry date 2031-09-27



A handwritten signature in purple ink, consisting of a series of loops and a final flourish.

Authorized Certification Decision Maker
Chris Miles

This is to certify that representative samples of the Certified Product listed above have been investigated by Underwriters Laboratories to the Standard(s) indicated on this Certificate, in accordance with the UL Global Services Agreement and the UL-EU Mark Service Terms and Conditions ("Agreement"). The Certificate Holder is entitled to use the UL-EU Mark for the Certified Product listed on the certificate and manufactured at the production site(s) listed, in accordance with the terms of the Agreement. Only those products bearing the UL-EU Mark for Europe should be considered as being covered by UL's UL-EU Mark Service. This Certificate shall remain valid through the Expiration date, unless a Standard identified on this Certificate is amended or withdrawn prior to that date or there is a non-compliance with the Agreement.



Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
Page 2/8
Date of Issue 2021-09-28

This certificate relates to the use of Firepro Softseal System coating/sealant for fire stopping where there are joints in or between floors and walls and for perimeter joint/cavity barrier seals between floor end and curtain walling. The detailed scope is given in pages 3 to 6 of this Certificate. This shows the thickness and acceptable dimensions, substrates and orientations required to provide fire resistance periods of up to 240 minutes (E 240/ EI 180).

The product is certificated on the basis of:

- i) Inspection and surveillance of factory production control by UL
- ii) Fire resistance test data in accordance with 1366-4: 2006
- iii) Fire resistance test data in accordance with 1364-4: 2014
- iv) Classification in accordance with EN 13501-2
- v) Durability and Servicability as defined in ETAG 026-3

The movement capability of Firepro Softseal System joint seals is restricted to $\leq 12.5\%$ (lateral movement)

The durability class of Firepro Softseal System is Z₁ -

intended for use at internal conditions with high humidity, excluding temperatures below 0°C



Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
 Page 3/8
 Date of Issue 2021-09-28

Product-type: Coating		Intended use: Linear Joint & Gap Seal
Basic requirement for construction work	Basic Requirement	Basic requirement for construction work
BWR 1 Mechanical resistance and stability		
-	None	-
BWR 2 Safety in case of fire		
EN 13501-1	Reaction to fire	No performance determined
EN 13501-2	Resistance to fire	See page 6
BWR 3 Hygiene, health and environment		
EN 1026:2000	Air permeability (material property)	See page 4
ETAG 026-3, Annex C	Water permeability (material property)	No performance determined
Declaration of manufacturer	Release of dangerous substances	Declaration of manufacturer
BWR 4 Safety in use		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003 ISO 11600	Adhesion	No performance determined
BWR 5 Protection against noise		
EN 10140-2/ EN ISO 717-1	Airborne sound insulation	Rw(C;Ctr)= 30 (-2;-8) dB
EN 10140-3/ EN ISO 717-2	Impact sound insulation	No performance determined
BWR 6 Energy economy and heat retention		
EN 12664, EN 12667 or EN 12939	Thermal properties	No performance determined
EN ISO 12572 EN 12086	Water vapour permeability	No performance determined
General aspects relating to fitness for use		
ISO 8339: 2005, ISO 9046: 2004 & ISO 7389: 2003	Durability and serviceability	Z ₁
BWR 7 Sustainable use of natural resources		
-	-	No performance determined



Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
 Page 4/8
 Date of Issue 2021-09-28

Firepro Softseal System: Air Permeability according to BS EN 1314-1				
Pressure (Pa)	Results under positive chamber pressure		Results under negative chamber pressure	
	Leakage (m ³ /h)	Leakage (m ³ /m ² / h)	Leakage (m ³ /h)	Leakage (m ³ /m ² / h)
50	0.1	0.1	1.0	1.4
100	0.3	0.4	1.1	1.5
150	0.6	0.8	1.5	2.1
200	0.8	1.1	0.9	1.3
250	1.1	1.5	1.3	1.8
300	1.2	1.7	1.7	2.4
450	2.4	3.3	3.5	4.9
600	4.5	6.3	5.3	7.4

Firepro Softseal System: Analytical VOC Results				
Solid content % mass	Water content, % mass	Exempt compounds, % mass	VOC less water less exempt compounds, g/l	VOC limit g/l
66.2	7.7*	0***	380	750*

* VOC limit for other sealants

** Given by client

*** No information about exempt compounds. Set to zero.

Firepro Softseal System: Water Permeability according to BS EN 1027*		
Pressure (Pa)	Duration	Observations
50	15 minutes	No Leakage Observed
100	5 minutes	No Leakage Observed
150	5 minutes	No Leakage Observed
200	5 minutes	No Leakage Observed
250	5 minutes	No Leakage Observed
300	5 minutes	No Leakage Observed
450	3 minutes 50 seconds	At a total duration of 43 minutes 50 seconds the right hand edge of the sample joint to subframe separated and began to allow water leakage off the sample

* Exposure from coated side



Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
 Page 5/8
 Date of Issue 2021-09-28

Firepro Softseal System: Acoustic performance according to BS EN ISO 10140-2:2010		
Configuration	$R_w(C; C_{tr})$ Specimen only, 1m ²	D_{new} Partition & Specimen, 14.2m ²
Firepro Softseal System on source room side of wall, 1mm deep x 500mm wide x 2000mm high, with 100mm deep Stonewool (80kg/m ³)	30 (-2; -8)	40 (2; -8)



Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
 Page 6/8
 Date of Issue 2021-09-28

Firepro Softseal System: Linear Gaps in Floors								
Substrate	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
AAC or Concrete	150	200	Top of floor	1 (DFT)	Stone Mineral Wool* Compressed by 20%	100	240	180

* 80 kg/m³

Firepro Softseal System: Linear Gaps in Walls								
Substrate	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
AAC or Concrete	150	150	Unexposed face	1 (DFT)	Stone Mineral Wool* Compressed by 20%	100	240	180

* 80 kg/m³




Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01201-CPR
 Page 7/8
 Date of Issue 2021-09-28

Firepro Softseal System: Perimeter Joint Seal/Cavity Barriers Between Floor End and Curtain Walling

Construction details:

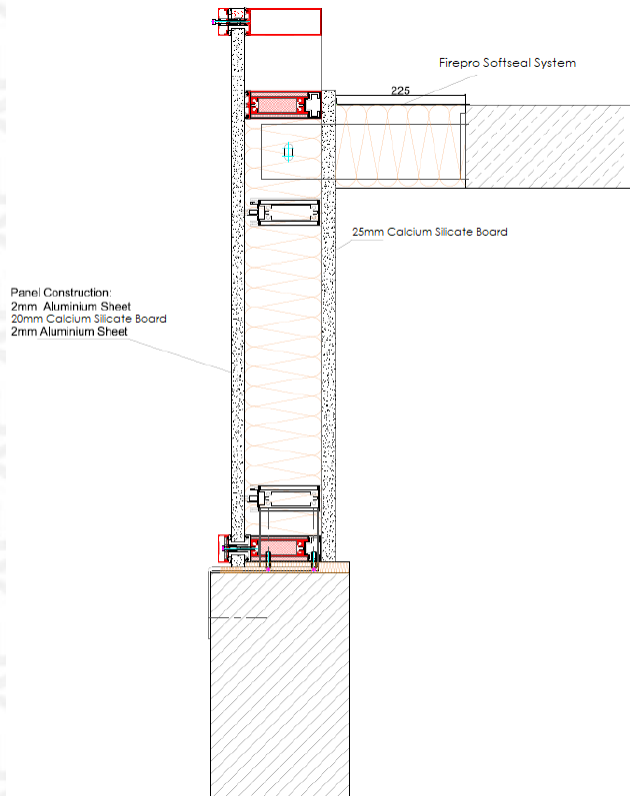

Substrate	Minimum Substrate Thickness (mm)	Maximum Gap Size (mm)	Seal Position	Minimum Seal Depth (mm)	Backing Material	Minimum Backing Depth (mm)	Fire Resistance (mins.)	
							E	EI
AAC or Concrete/ Curtain Wall#	150	225	Top of backing material. Overlapping floor and curtain wall at minimum 15 mm	1 (DFT)	Stone Mineral Wool* Compressed by 20%	100	120	120

* 80 kg/m³

#Curtain wall comprising an aluminium profile system of mullions and transoms, with 1 x 25 mm thick layer of Calcium silicate board mounted on the inside of the spandrel panel system and a stonewool based core within the spandrel panel.

27-CP-F0855 Issue: 3.1



Appendix UL-EU Certificate

Certification Mark	UL-EU mark
Certificate No.	UL-EU-01201-CPR
Page	8/8
Date of Issue	2021-09-28

The UL-EU Mark, as displayed below, shall appear on certified products only. Minimum size is not specified, as long as the Mark is legible. The following is suggested.



The minimum height of the registered trademark symbol ® shall be 1 mm. When the overall diameter of the UL-EU Mark is less than 9.5 mm, the trademark symbol may be omitted if it is not legible to the naked eye.

The UL-EU Mark may appear on a label, nameplate, or may be cast, stamped or molded into the product. When appearing on a label or nameplate, the Manufacturer's name or trademark along with a model number are also required on that same label or nameplate. If cast, stamped or molded, the Manufacturer's name or trademark and model number shall also appear elsewhere on the product.

All content shall be in accordance with the details provided on this UL-EU Certificate.

PROCUREMENT

The Production site may reproduce the Mark or obtain it from a UL authorized supplier. The list of UL authorized suppliers can be found on UL's online directory at www.ul.com.

